

A.1

A

B B.1


C.1

C

D

E

F

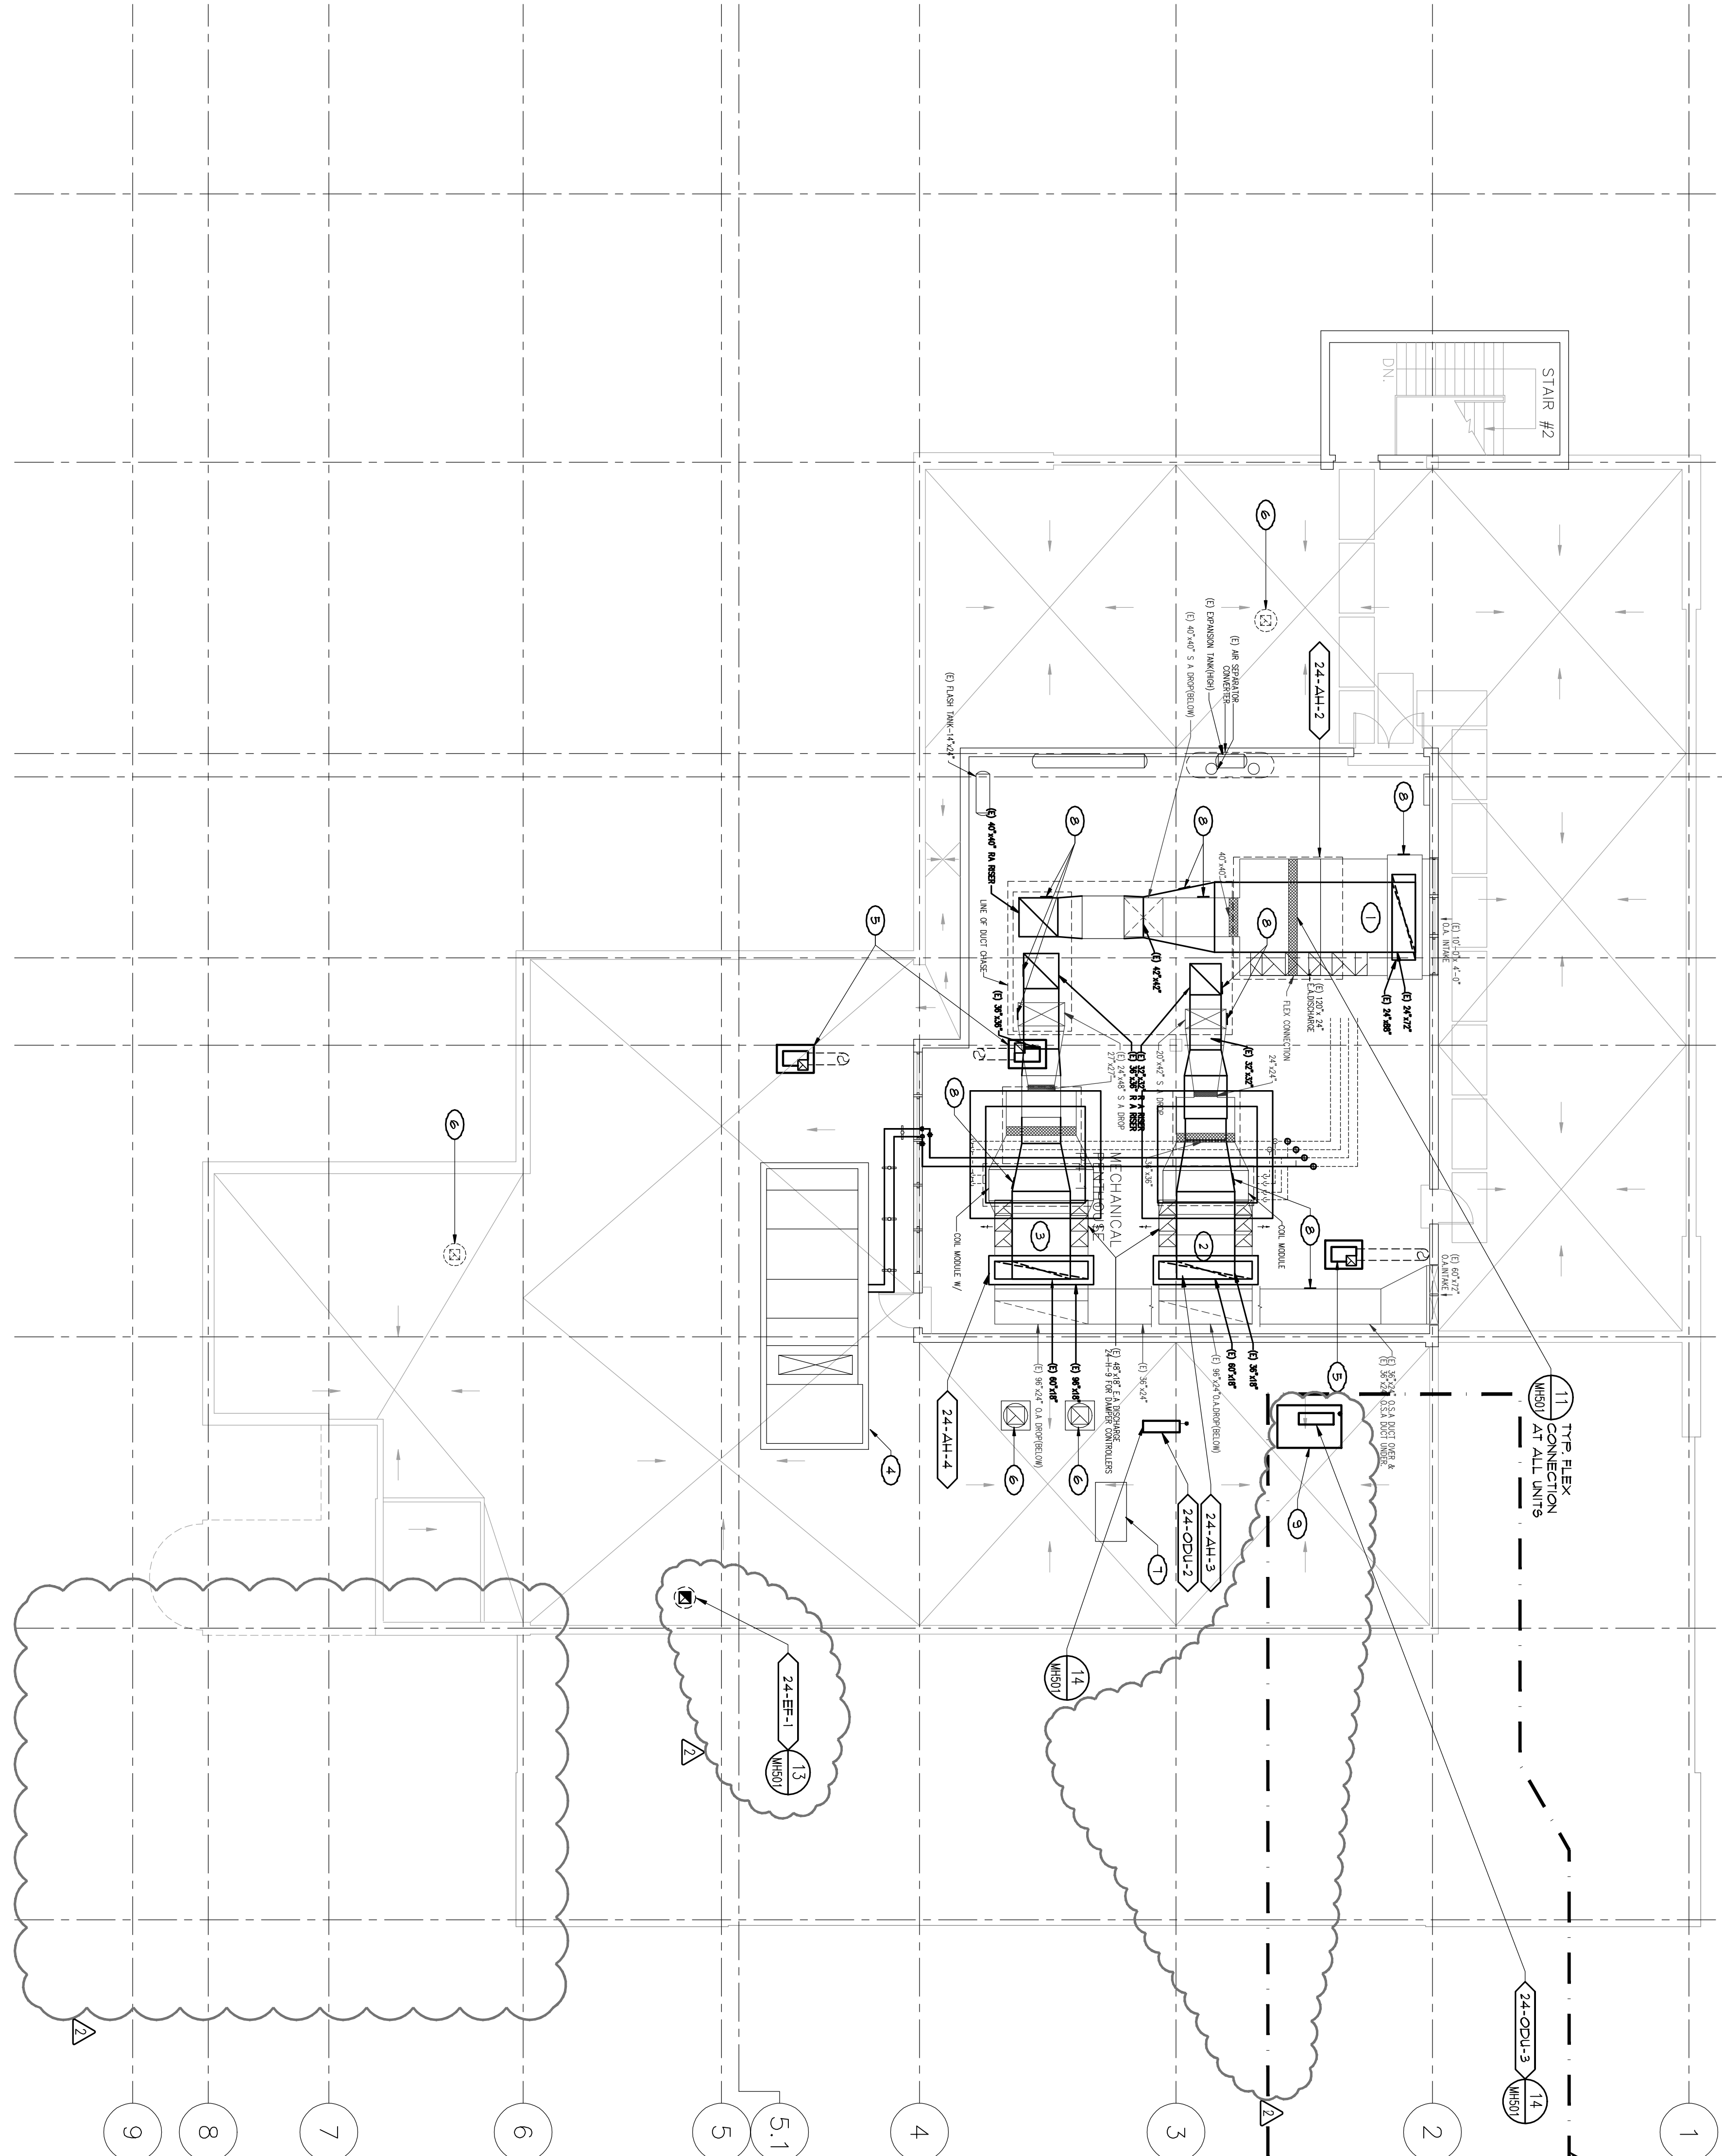


KEY NOTES

- 1. (E) AH-4 TO REMAIN. REPLACE INDIVIDUAL SUPPLY FAN AND BELT DRIVE. REPLACE ALL CONTROLS WITH NEW DIGITAL CONTROLS. CLEAN COILS, DRAIN PANS AND VACUUM OUT PANS. ADD SERVICE BRACING TO MAIN DUCTWORK AND COIL PIPING.
- 2. (E) AH-3 TO REMAIN. REPLACE INDIVIDUAL SUPPLY FAN AND BELT DRIVE. REPLACE ALL CONTROLS WITH NEW DIGITAL CONTROLS. CLEAN COILS, DRAIN PANS AND VACUUM OUT PANS. ADD SERVICE BRACING TO MAIN DUCTWORK AND COIL PIPING.
- 3. (E) AH-2 TO REMAIN. REPLACE INDIVIDUAL SUPPLY FAN AND BELT DRIVE. REPLACE ALL CONTROLS WITH NEW DIGITAL CONTROLS. CLEAN COILS, DRAIN PANS AND VACUUM OUT PANS. ADD SERVICE BRACING TO MAIN DUCTWORK AND COIL PIPING.
- 4. (E) AH-1 TO REMAIN. REPLACE INDIVIDUAL SUPPLY FAN AND BELT DRIVE. REPLACE ALL CONTROLS WITH NEW DIGITAL CONTROLS. CLEAN COILS, DRAIN PANS AND VACUUM OUT PANS. ADD SERVICE BRACING TO MAIN DUCTWORK AND COIL PIPING.
- 5. (E) AH TO REMAIN.
- 6. (E) RAIN. HOOD UTILITY TYPE EXHAUST FAN ON ROOF TO REMAIN. REPLACE (3) 12 GAUGE GUIDE WIRE TO STRUCTURE TO SUPPORT 1'-0" HIGH DUCT OUTLET STACK.
- 7. (E) ROOFTOP EXHAUST FAN TO REMAIN.
- 8. (E) TRANSFORMER TO REMAIN.
- 9. PROVIDE GASKETED REMOVABLE ACCESS PANEL ON SIDE OF (E) DUCT TO REMAIN AND CLEAN DUCT PER SPEC SECT. NOTES ON SHEET M4602.
- 10. EQUIPMENT PLATFORM SHALL BE 3'-0" X 5'-0" FOR SERVICE VERY OUTDOOR UNIT INSTALLATION.

EQUIPMENT NOTE


SEE SHEET M4602 AND M4601 FOR EQUIPMENT SCHEDULES

1 PENTHOUSE MECHANICAL REMODEL FLOOR AND ROOF PLAN



CONSULTANTS:

LP Consulting Engineers, Inc.
685 W. Ashland Ave., Suite 101, Chula, CA 92012
P: 619.425.1511
www.lpconsulting.com
Joe R. 10-1000

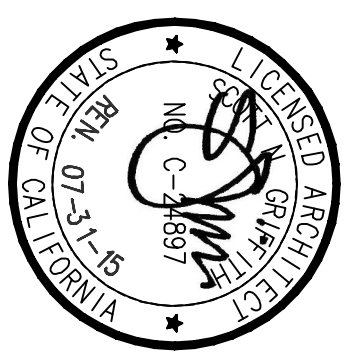

HMC Architects
1827 E. Pi Avenue, Suite 103, Fresno, CA 93720
T: 559.322.2444 / www.hmcarchitects.com

Drawing Title	Project Title	Project Number	Office of Construction and Facilities Management Department of Veterans Affairs
PENTHOUSE MECHANICAL REMODEL FLOOR AND ROOF PLAN DEDUCTIVE ALTERNATE 8	BUILDING 24 SEISMIC CORRECTION AND ADDITION	570-215	
Approved Project Director	Location VAMC FRESNO, CA	Building Number 24	
Date 7/26/2019	Checked KK	Drawn DN	Drawing Number MH114
Dwg 155 of 176			